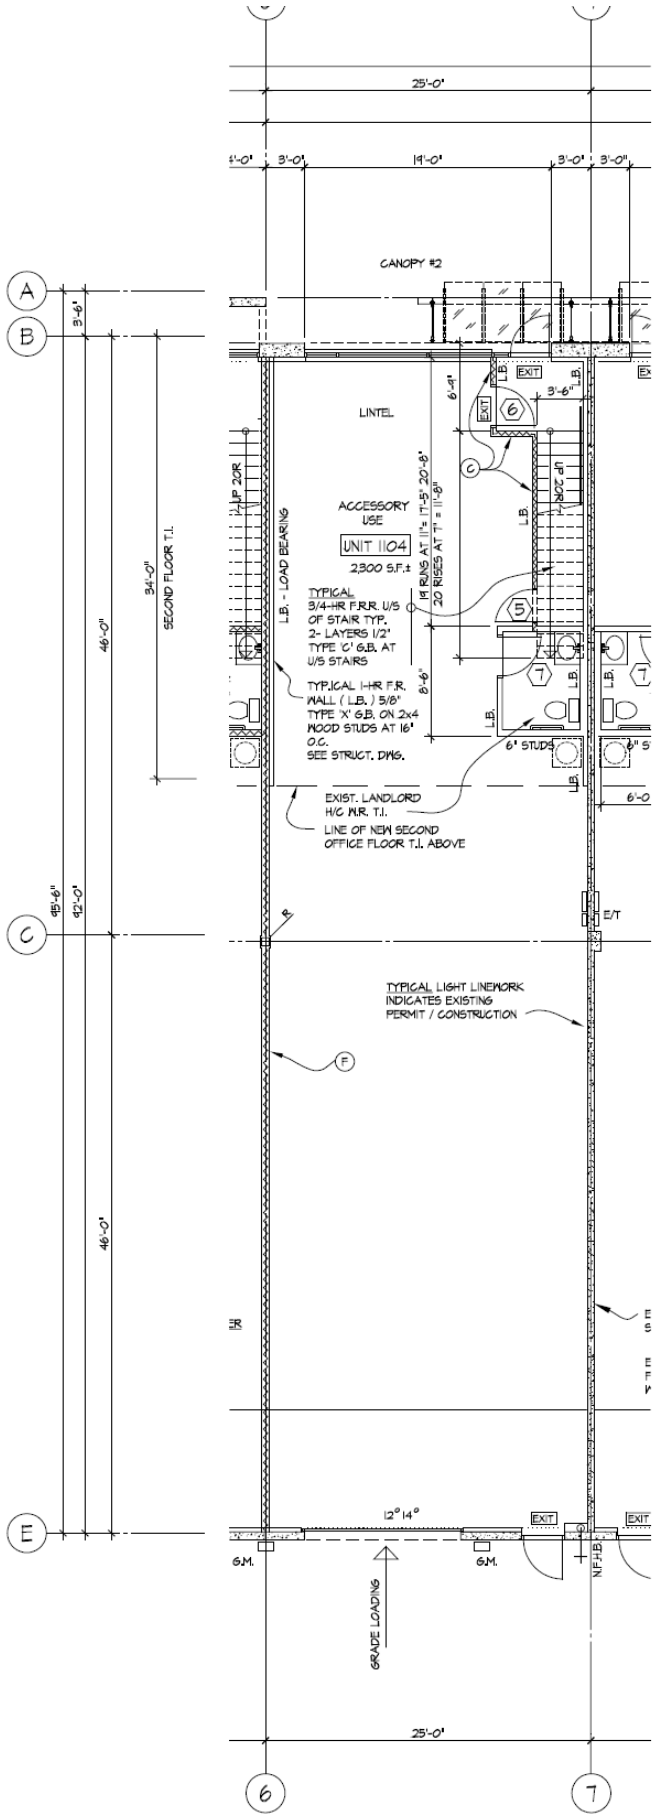

TYP. STAIR CONSTRUCTION
2X12 STRINGERS AT 24" O.C. MAX. C/M 1" PLY TREADS, GLUED & SCREWED TO STRINGERS, 1/2" PLY RISERS. NAIL OUTSIDE STRINGERS TO WALLS & USE 2X4 STIFFENER EA. SIDE OF CENTER STRINGER. INSTALL OUTSIDE STRINGERS AFTER TYPE 'X' GB. IS IN PLACE.

REFER TO TYPICAL TENANT IMPROVEMENT SECTION FOR STAIR DETAIL REFERENCES PER BASE BUILDING
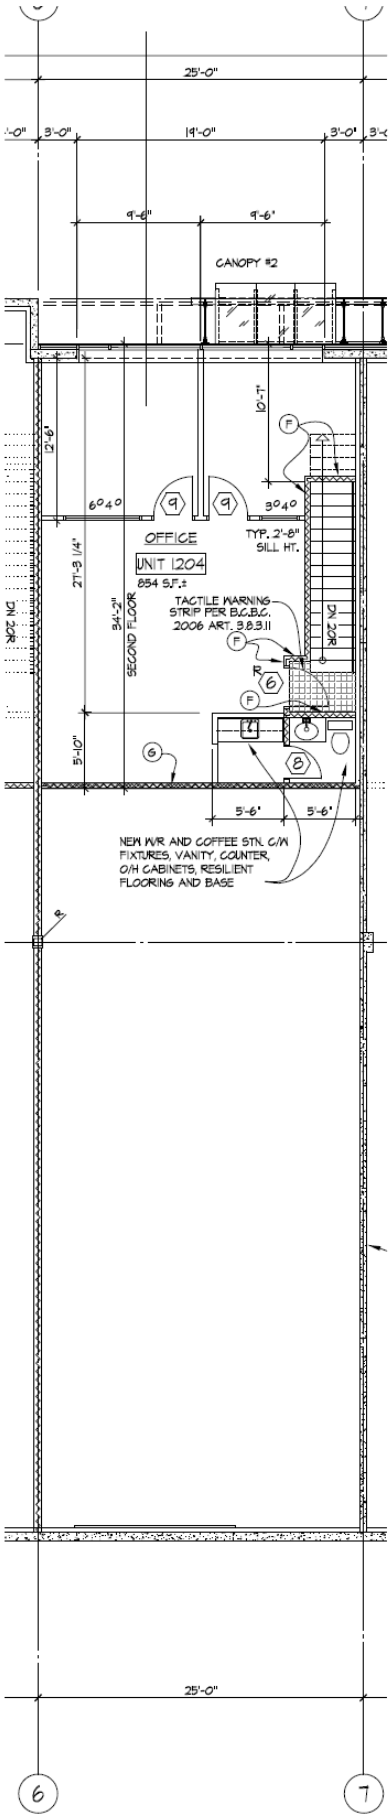
3/4 HOUR F.R. FLOOR SYSTEM
T.JM/FCA 45-01 ASSEMBLY:
3/4" T & G OSB DECKING ON
14" T.JI TRUS JOISTS BY TRUSJOIST ONLY, OR OBTAIN BUILDING DEPT. APPROVAL PRIOR TO INSTALLATION,
(JOISTS - SEE STRUCT. DWGS)
F.R. JOISTS EVERY 160 CU. FT.
4" BATT SOUND INSULATION
5/8" TYPE X G.B. TO U/S JOISTS