KITCHEN EQUIPMENT LIST		
ITEM	DESCRIPTION	ELECT.
1	SOUP KETTLE	115V, 10AMP
2	HOBART FLASHBAKE OVEN	240V 30-40A OTHER REQ'D
3	TOASTER	208V, 16AMP
4	SANDWICH TABLE	115V, 8 AMP
5	DELI COOLER	115V, 8 AMP
6	DELI COOLER	115V, 8 AMP
7	ESPRESSO MACHINE	240V, 20 AMP
8	COFFEE MAKER	120V, 60Hz, 15 20A
9	COFFEE MAKER	120V, 60Hz, 15 20A
10	DISHWASHER	115V, 35 AMP
11	[illegible]	115V, 4.75 AMP
12	BLENDER	115V, 3.6 AMP
13	DISPLAY BEVERAGE COOLER	115V, 8.4 AMP
14	UC ICE MACHINE	120V, 3 AMP
15	UC FREEZER	115V, 9.3 AMP

NOTES:

1. ALL FOOD CONTACT SURFACES TO BE STAINLESS STEEL OR FOOD APPROVED SURFACES (PLASTIC LAMINATE) FOR PROPER CLEANING AND SANITIZING.
2. FLOOR TO BE TILE APPROVED FOR FOOD ESTABLISHMENTS.
3. ALL PAINTED SURFACES WILL BE DONE IN PAINTS APPROVED FOR FOOD ESTABLISHMENTS.

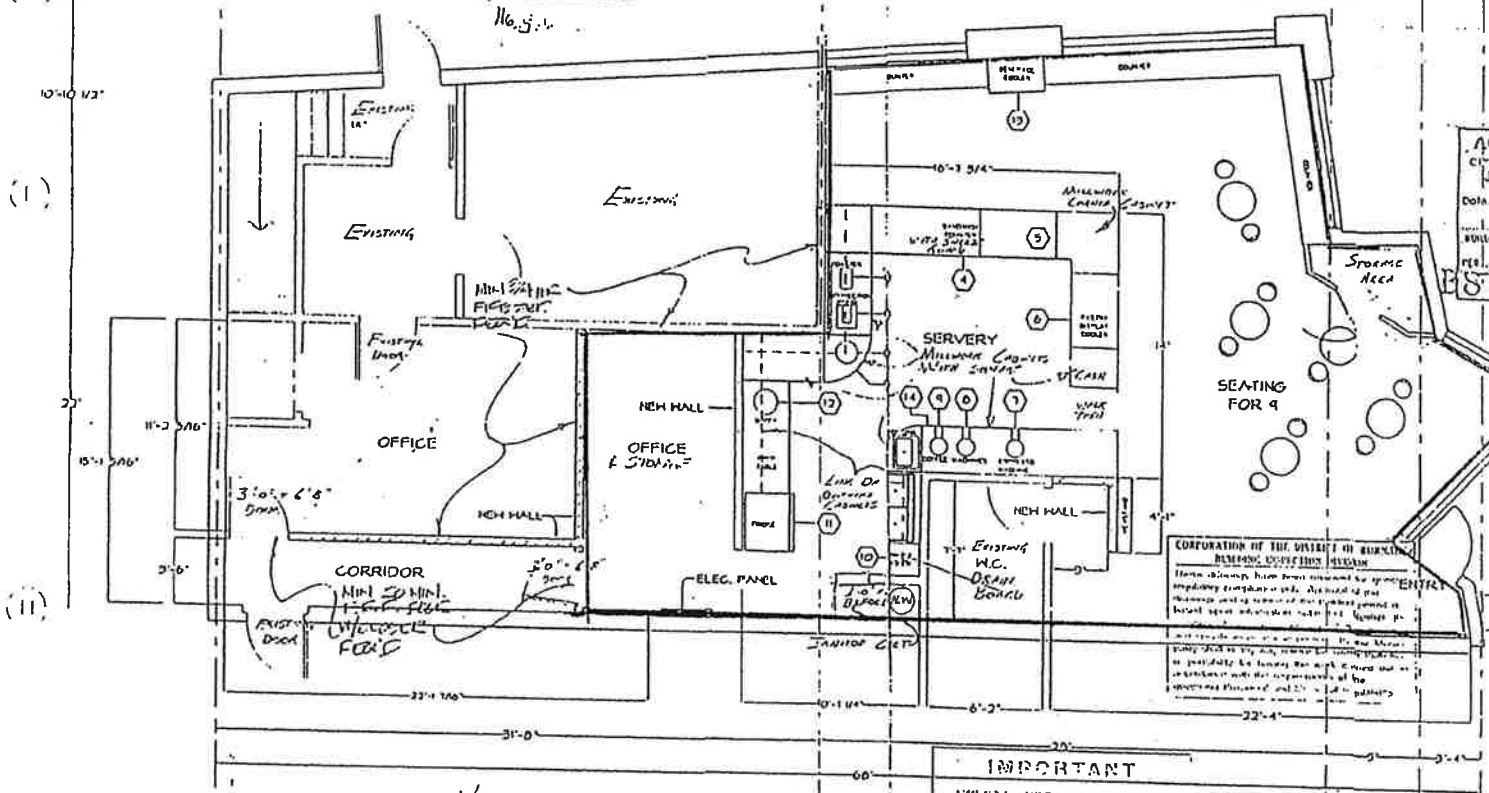

IMPORTANT

Location and number of exit signs and emergency lighting is subject to the approval of the Building Inspector.

Notes

Ceiling - T-Bar Grid with Foam Panel [illegible] Not Tegular [illegible] Some Downlights & Track Downlights At the Line & In [illegible]

17-11-18
Date

Note:
- Ensure sprinklers are NOT obstructed by partitions, decorations, signs etc.
- Any relocations or additions to sprinkler systems require a NFPA, [illegible] approval from the Fire Department
- Full compliance to the [illegible] is a requirement

SEPTEMBER 1998

13

REVIEWED & ACCEPTED
Deficiencies noted
Requirements in red
D.C. Fire Dept. Building Code
22-11-96 235

ACCEPTED
CITY OF [illegible]
JAN 8 1998
Date
BUILDING INSPECTOR
Per
B55282

RECEIVED
BUILDING DEPARTMENT
DEC 05 1997

REGISTER No.
ATTACHMENTS

SPECIFICATIONS

CORPORATION OF THE DISTRICT OF BURNABY
BUILDING INSPECTION DIVISION

IMPORTANT

PROJECT

THE DELI
3855 HENNING DR

INSPECTIONS - 294-7130

SHEET TITLE

FLOOR PLAN

SCALE	1/4"=1'-0"	DRAWN	RMO
DATE	11/10/97	SHEET	1 OF 1